


EQUATIONS FOR CALCULATING  
STALL DIMENSIONS

$$S = \frac{W}{\sin \theta}$$

$$R = \frac{W}{\tan \theta}$$

$$D = (L + R) \sin \theta$$

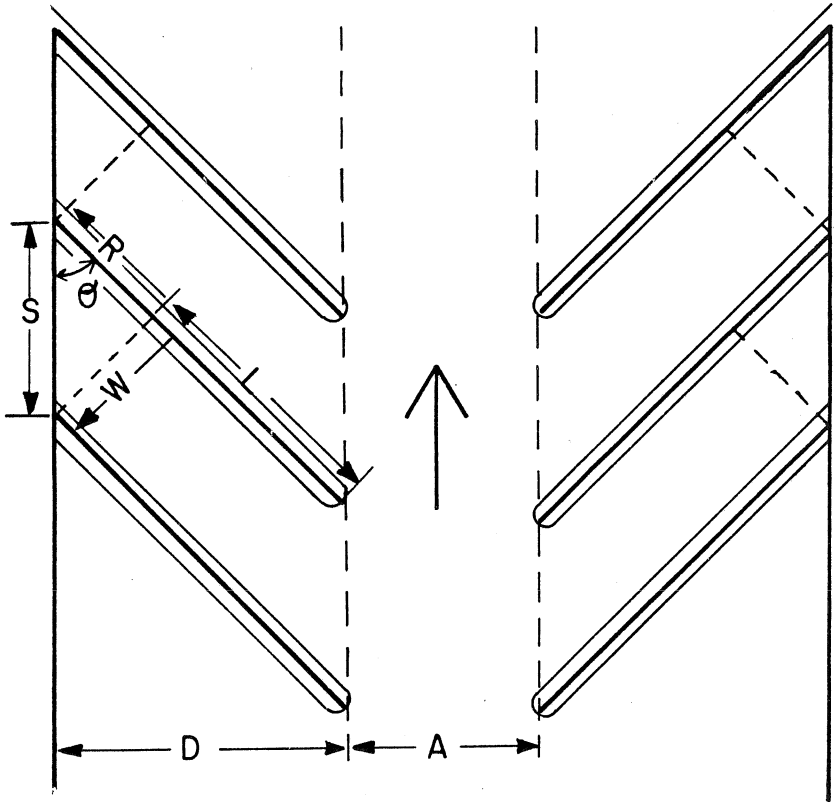

FOR ONE DIRECTION AISLE:

$$A = B \sin \theta, \text{ min} = 12'$$

FOR TWO DIRECTION AISLE:

$$A = B \sin \theta, \text{ min} = 22'$$

COMPACT STALLS:

$$W = 8', L = 17', B = 22'$$

B = BACKUP DISTANCE

STANDARD STALLS:

$$W = 8'6", L = 18', B = 24'$$

MINIMUM PARKING LOT DIMENSIONS (in ft.)


$\theta$	S		R		D		A (1 DIR)		A (2 DIR)	
	COM.	STD.	COM.	STD.	COM.	STD.	COM.	STD.	COM.	STD.
0°	21	22	0	0	7.0	8.0	13.0	14.0	22.0	22.0
30°	16.0	17.0	13.9	14.7	15.5	16.4	12.0	12.0	22.0	22.0
45°	11.3	12.0	8.0	8.5	17.7	18.7	15.6	17.0	22.0	22.0
60°	9.2	9.8	4.6	4.9	18.7	19.8	19.1	20.8	22.0	22.0
90°	8.0	8.5	0	0	17.0	18.0	22.0	24.0	22.7	24.0

CITY OF SAN MATEO

CALIFORNIA 94403

PARKING STANDARDS  
PARKING LOT DIMENSIONS


DATE DEC '85	DRAWN BY DMB	CHECKED E.B.	APPROVED <i>Ann Perry</i> CITY ENGINEER	CASE 3	DRAWER 1	SET 190
-----------------	-----------------	-----------------	---	-----------	-------------	------------

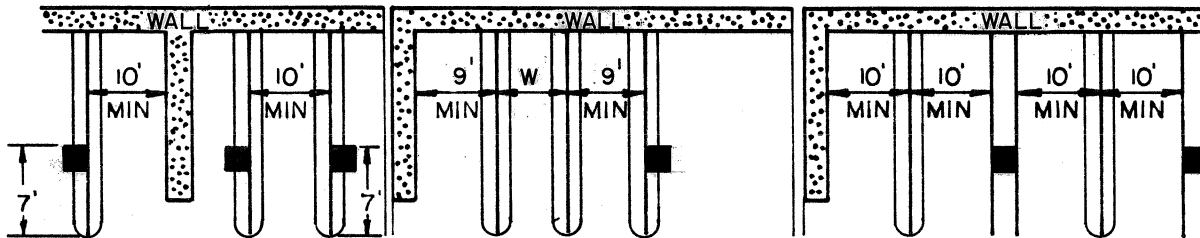

CONFINED STALLS      RESTRICTED STALLS

TWO ADJACENT RESTRICTED  
OR END STALLS

**STANDARD STALLS**  
(FOR COMPACT STALLS, SUBTRACT ONE FOOT  
FROM THE ABOVE DIMENSIONS)

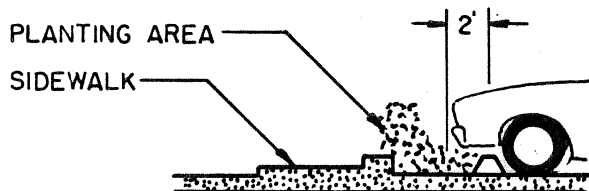


PERMISSIBLE BUMPER OVERHANG

FOR ADDITIONAL INFO:  
SEE S.M.M.C. Chapter 27.64  
OFF-STREET PARKING  
AND LOADING


**PARKING STANDARDS**  
**PARKING LOT LAYOUTS**  
SAN MATEO, CALIF.

DATE	DRAWN BY	CHK. BY	APPROVED	PLAN CASE	DRAWER	SHEET
6-86	K.K.L.		<i>Arnon Perry</i>	3	1	191
			CITY ENGINEER			

NOTE: SUFFICIENT AREA WILL BE PROVIDED NEAR THE END OF DEAD-END AISLES FOR TURN AROUND UNDER FULL LOT CONDITIONS.

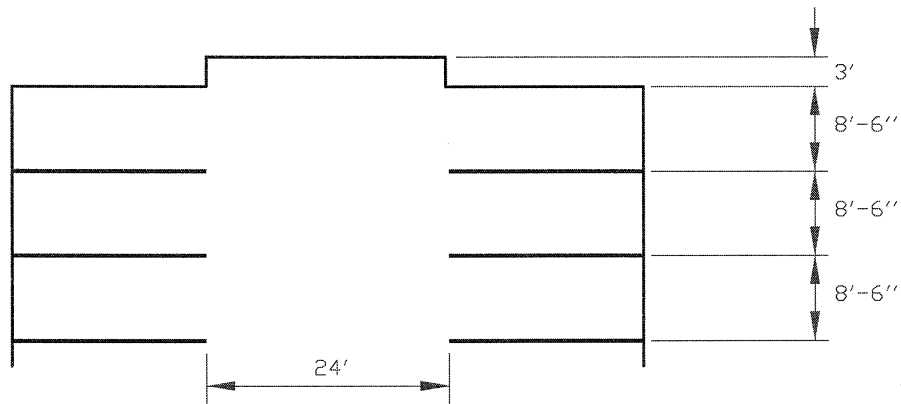

### DEAD-END AISLES

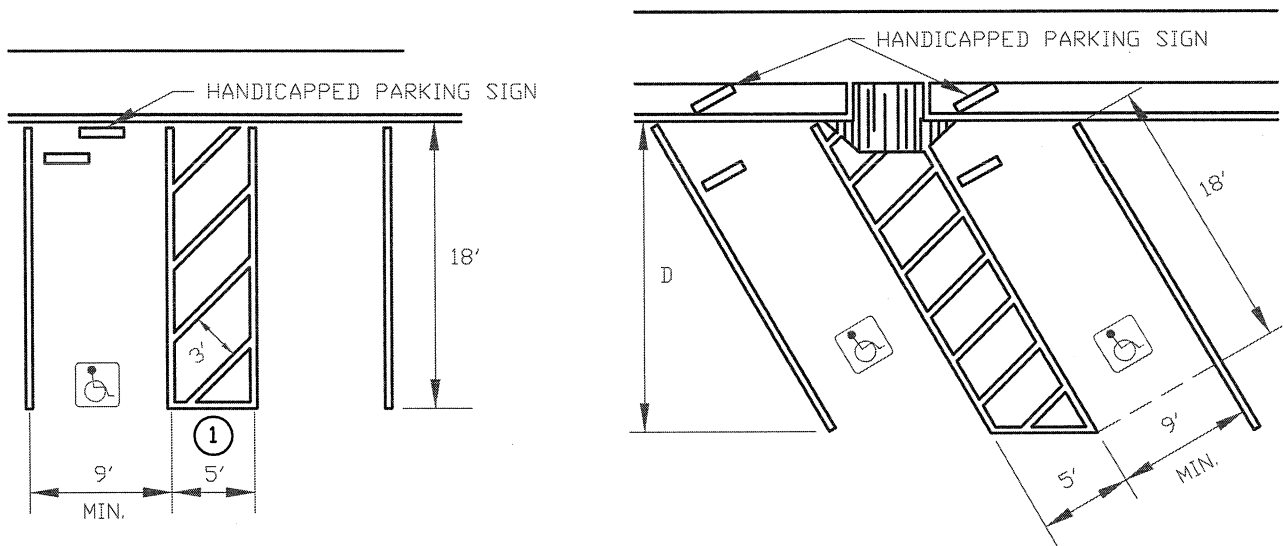

### HANDICAPPED PARKING

NOTE:

- ① 8' PASSENGER LOADING ZONE REQUIRED FOR VAN ACCESSIBLE SPACES. LOADING ZONE ON PASSENGER'S SIDE OF STALL UNLESS SHARED.





ENGINEERING DEPARTMENT

CALIFORNIA 94403



## PARKING STANDARDS

DATE	DRAWN BY	CHECKED BY	APPROVED	CASE	DRAWER	SET
2002	PC	OC	<i>Paul O'Keefe</i> CITY ENGINEER	3	1	192

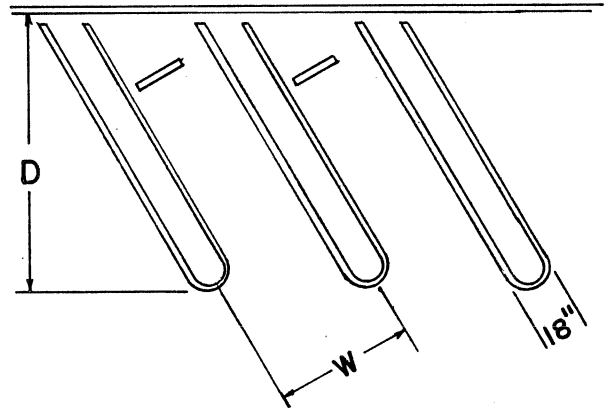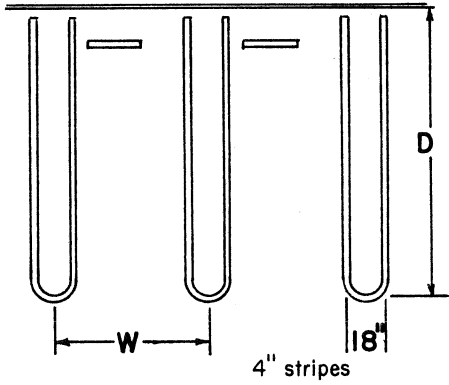

**DOUBLE STRIPING**

NOTE: 4" STRIPE APPROXIMATELY 18" APART WITH ROUNDED OR SQUARED ENDS

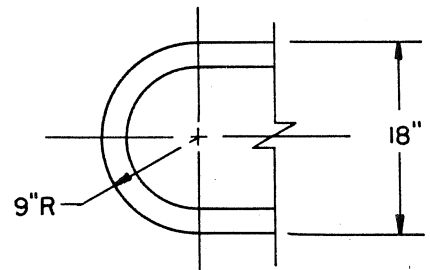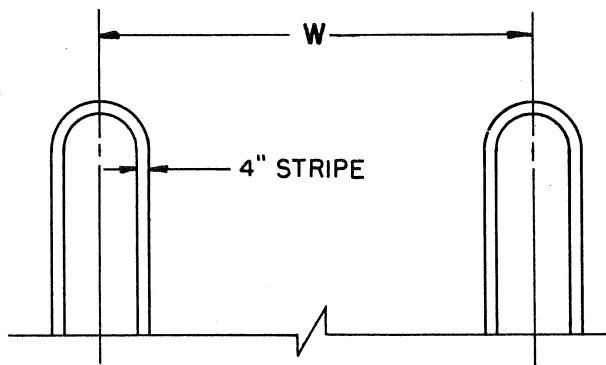

**STALL DOUBLE STRIPING DETAIL**


SEE SHEET 3-1-190

CITY OF SAN MATEO

CALIFORNIA 94403


**PARKING STANDARDS  
DOUBLE STRIPING**

DATE	DRAWN BY	CHECKED	APPROVED	CASE	DRAWER	SET
6-86	K.K.L.		<i>Ann Perry</i> CITY ENGINEER	3	1	193

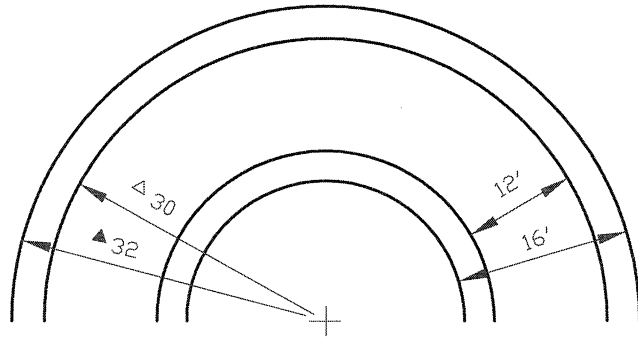

ONE WAY

- △ RADIUS TO CURBS LOWER THAN 6" (WHEEL RADIUS)
- ▲ RADIUS TO COLUMNS, WALLS OR STRUCTURES. (BODY OVERHANG RADIUS)

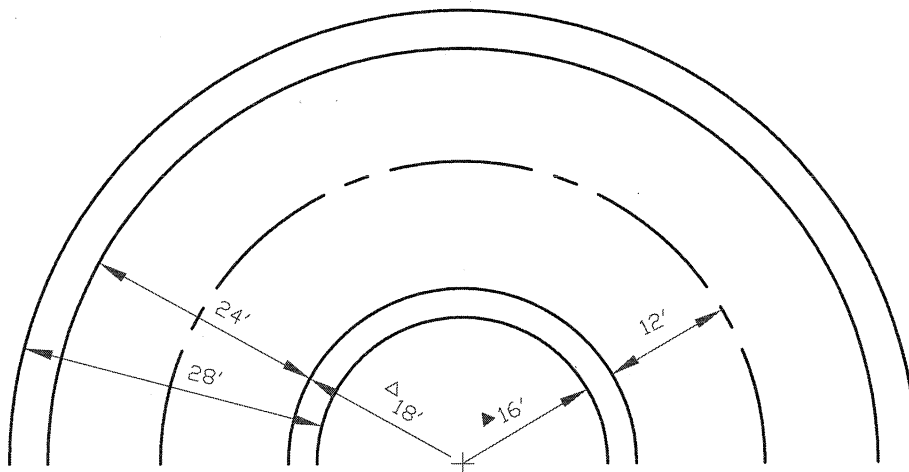

TWO WAY

FOR ADDITIONAL INFORMATION:  
 SEE S.M.M.C. CHAPTER 27.64  
OFF-STREET PARKING AND LOADING

MIN. WIDTH FOR RAMPS - TWO-WAY 24' CURB TO CURB; 28' WALL TO WALL  
 ONE-WAY 12' CURB TO CURB; 16' WALL TO WALL.



ENGINEERING DEPARTMENT

CALIFORNIA 94403

**PARKING STANDARDS**  
**MINIMUM TURNING RADII ON RAMPS**

DATE	DRAWN BY	CHECKED BY	APPROVED	CASE	DRAWER	SET
2002	PC	OC	<i>Mark Adams</i> CITY ENGINEER	3	1	194